
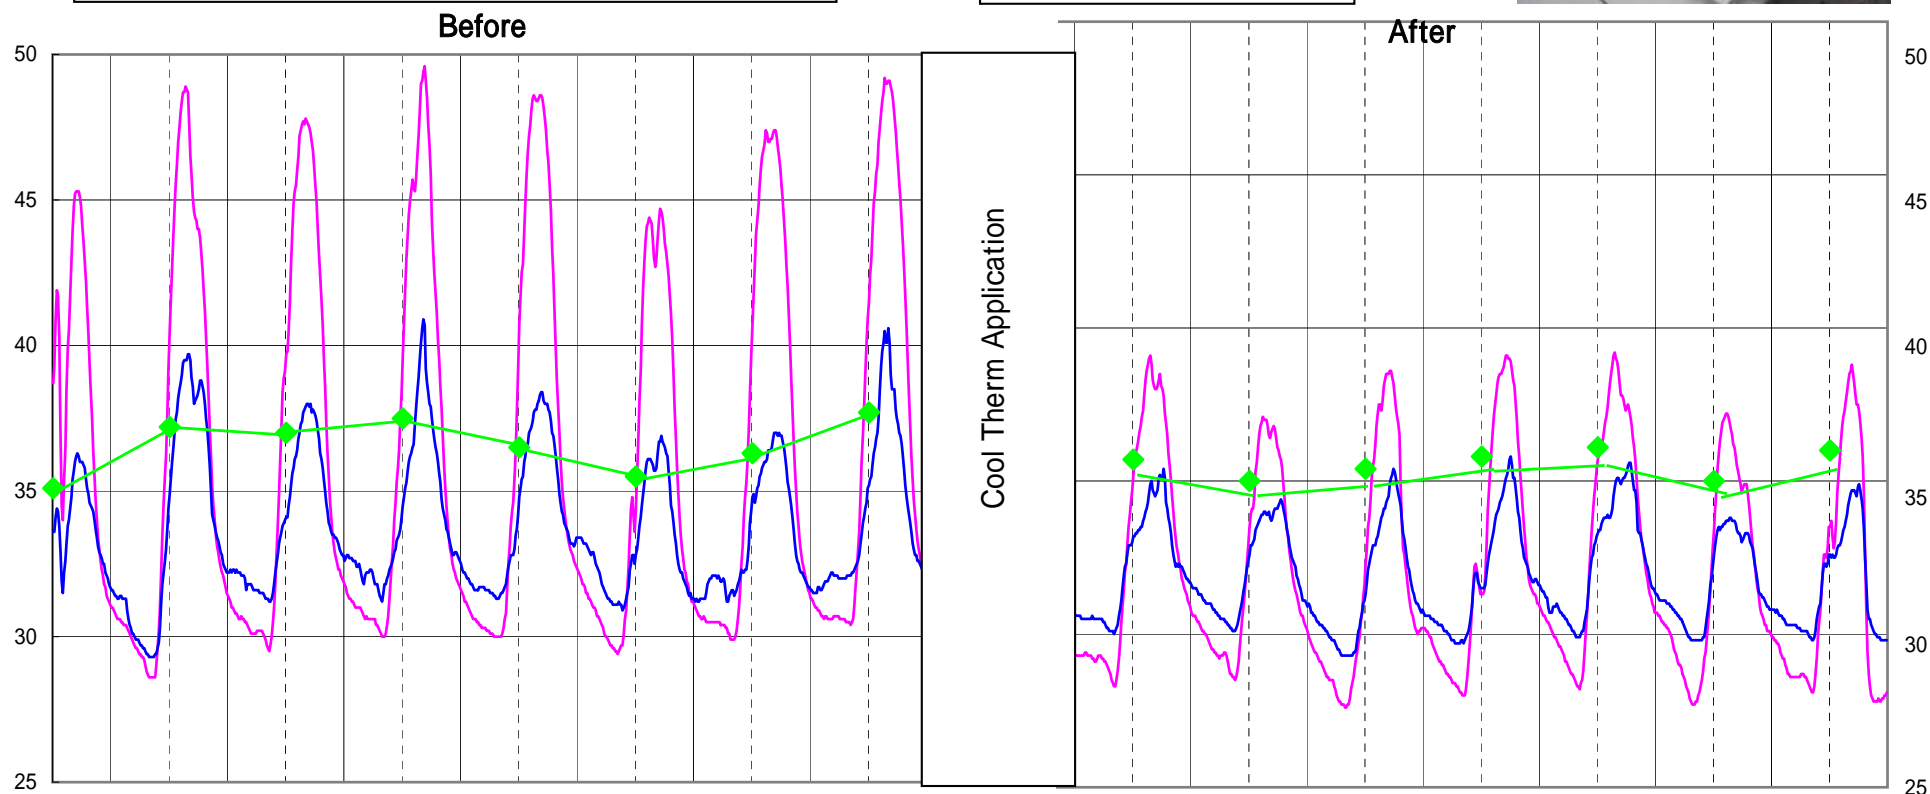


Thai Toray Synthetics Co., Ltd

Date: May, 2004 Area: 1,100 sqm

The temperature has reduced by about 10 °C inside the ceiling/attic, and the room temp. by about 3.5 °C. The temperature at night has also reduced by 2 to 3 °C.

— Outside — Ceiling/Attic — Room

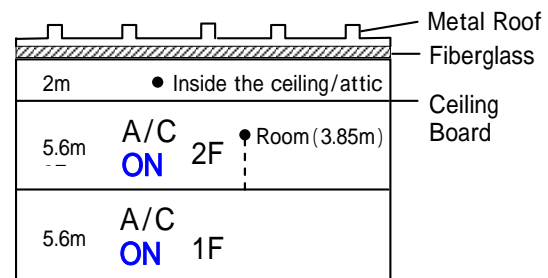

Date	4/6	4/7	4/8	4/9	4/10	4/11	4/12	Cool Therm Application	5/30	5/31	6/1	6/2	6/3	6/4	6/5
Max. Outside Temp.	37.2	37.0	37.5	36.5	35.5	36.3	37.7		35.7	35.0	35.4	35.2	36.1	35.0	36.0
Max. Ceiling Temp.	48.9	47.8	49.6	48.6	44.7	47.4	49.2		39.1	37.1	38.6	39.1	39.2	37.2	38.8
Max. Room Temp.	39.7	38.0	40.9	38.4	36.9	37.0	40.6		35.4	34.4	35.4	35.8	35.6	33.8	34.9

*The Max. outside temp. is presented by the Meteorological Office in Bangkok

*The temperature inside the ceiling and the room temperature were measured with COMPACT WATERPROOF DATA LOGGER (T&D)

Daiko Shokai (Thailand) Co., Ltd